

FIRE ALARM PANEL

FAPN202-R-5L

FEATURES


- Conventional type 5 fire zones (No programming required)
- Alarm verification type (Alarm verification time: 60 seconds)
- Various test functions: fire indication test, alarm verification time test, auxiliary power supply test, automatic after-test resetting
- Self diagnosis system
- Misoperation inhibit function
- Back-up power supply (Ni-Cd battery, 24VDC)
- Large fire alarm symbol for easy visual recognition
- Durable LED indicators
- Removable front cover for easy installation and maintenance
- Built-in surge arrester for power lines

DESCRIPTION


On receiving a fire signal from a fire detector or a manual alarm box, the FAPN202-R-5L conventional fire alarm panel produces visual alarms indicating the alarm point, as well as sounding an audible alarm to alert the alarm panel operator. It also produces alarms to alert the occupants of the building premises.



TYPICAL WIRING DIAGRAM

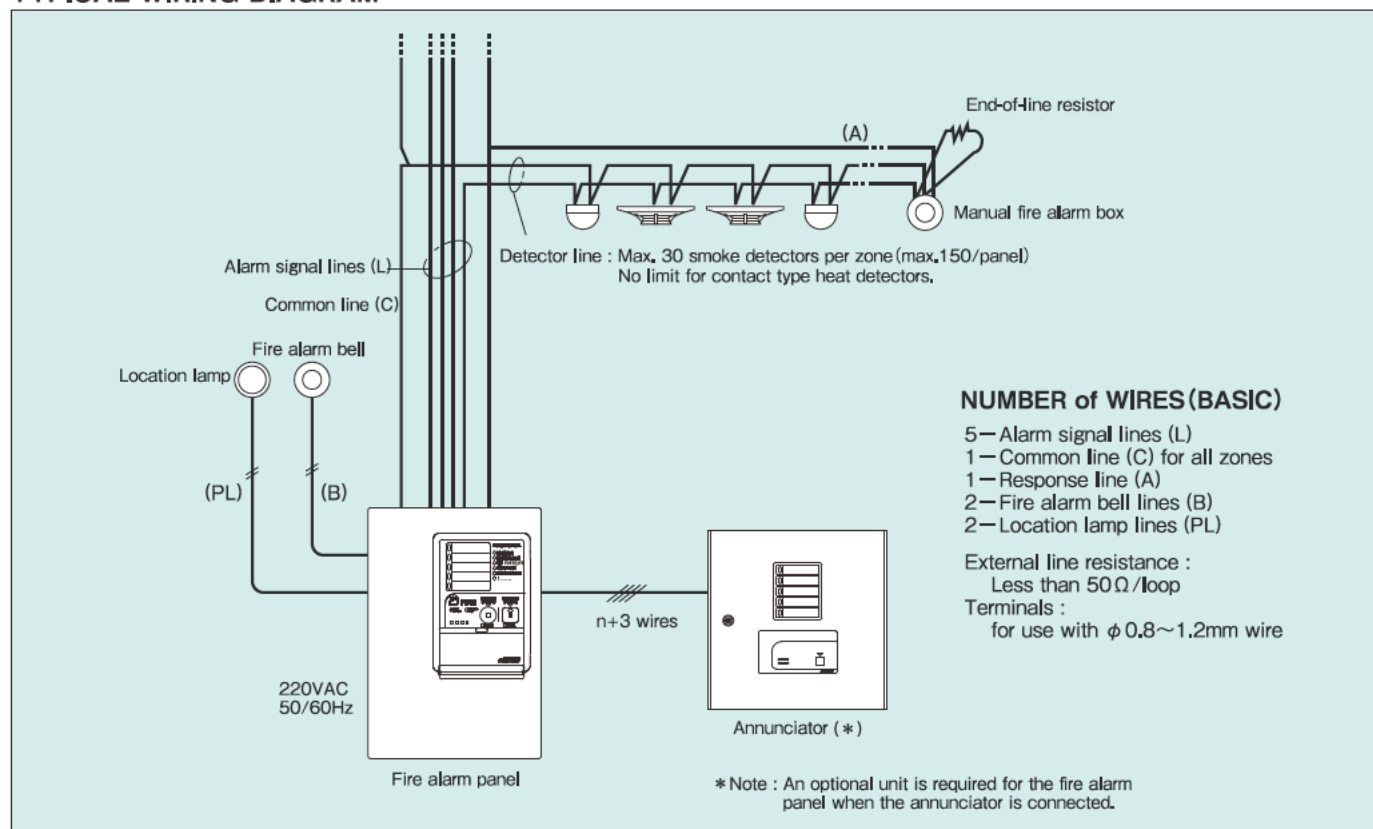

DIMENSIONS (WALL MOUNTED TYPE)

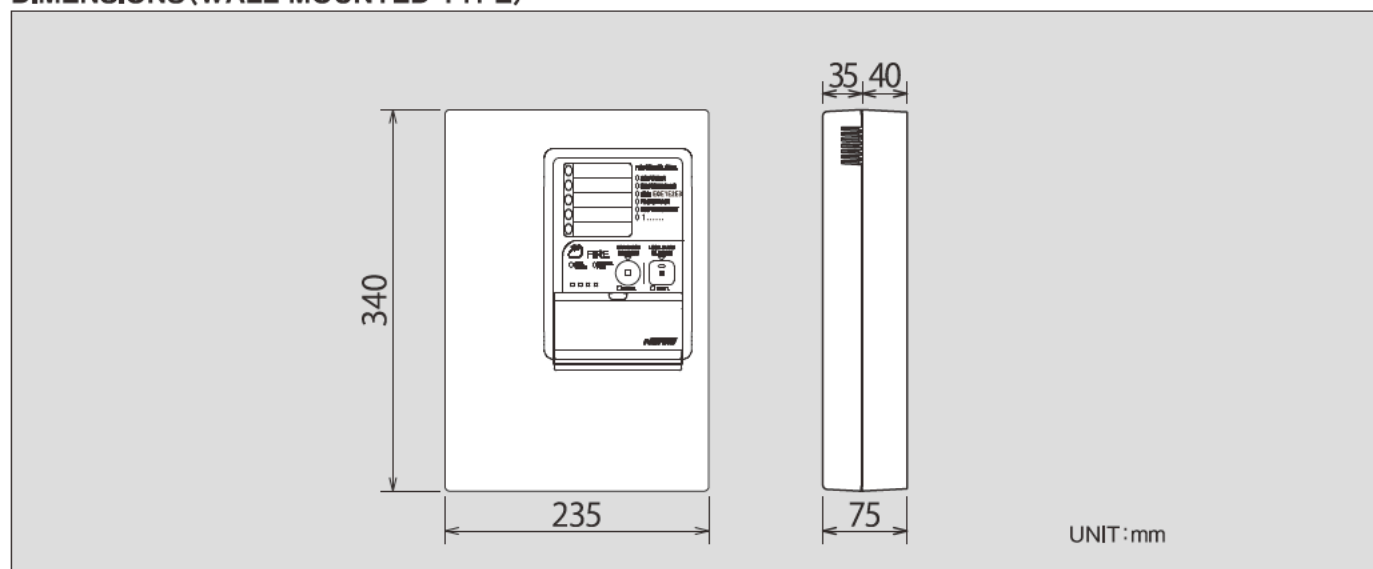

NOTE

- The information contained herein does not purport to cover all the details or variations of the equipment described, nor to provide for every possible contingency that may be met in connection with its installation, operation or maintenance.
- Specifications are subject to change without notice. Contact Nohmi before relying on the information.
- Actual performance is based on proper application of the product by a qualified professional.
- Should further information be required or should particular concerns arise that are not covered sufficiently for the purchaser's purposes, the matter should be referred to Nohmi or your nearest distributor.

NOHMI
NOHMI BOSAI LTD.

●HEAD OFFICE : 7-3, Kudan Minami 4-chome,
Chiyoda-ku, Tokyo 102-8277, Japan

●PHONE : (81)3-3265-0231

●F A X : (81)3-3265-5348

●U R L : <http://www.nohmi.co.jp/english/>